

# ANNUAL DRINKING WATER QUALITY REPORT FOR 2019



## YORKTOWN CONSOLIDATED WATER DISTRICT

1080 Spillway Road  
Shrub Oak NY 10588

Public Water Supply  
# NY5903469

Matthew J. Slater  
*Town Supervisor*

Ken Rundle  
*Distribution  
Superintendent*

Call (914) 245-6111  
with questions  
concerning your  
drinking water

### INTRODUCTION

To comply with State and Federal regulations, the Yorktown Consolidated Water District (YCWD) annually issues a report describing the quality of your drinking water. The purpose of this report is to raise your understanding of drinking water and awareness of the need to protect our drinking water resources.

This report provides an overview of last year's water quality, including details about your sources of water, what it contains, and how it compares to State and Federal standards. Last year your tap water met or exceeded all New York State and Federal drinking water health standards.

### WHERE DOES OUR WATER COME FROM?

In general, the sources of drinking water (both tap and bottled) include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activities. Contaminants that may be present in source water include microbial, inorganic, organic chemical, and radioactive contaminants, and pesticides and herbicides. In order to ensure that tap water is safe to drink, the State and the EPA prescribe regulations that limit the amount of certain contaminants in water provided by public water systems. The State Health Department's and the FDA's regulations establish limits for contaminants in bottled water, which must provide the same protection for public health.

During 2019, our major water sources were the Amawalk Reservoir, located in the Town of Somers, the Catskill Aqueduct in the Town of Cortlandt and City of Peekskill water during brief Catskill Aqueduct shutdown during 4th quarter. Prior to distribution, water at the Catskill and Amawalk Water Treatment Plants is treated with pH adjustment, coagulation, filtration, chlorine disinfection (see INFORMATION ON FLUORIDE ADDITION section of this report), and corrosion control.

The NYS Department of Health (DOH) has evaluated the susceptibility of water supplies statewide to potential contamination under the Source Water Assessment Program (SWAP), and their findings are summarized in the paragraphs below. It is important to stress that these assessments were created using available information and only estimate the potential for source water contamination. Elevated susceptibility ratings do not mean that source water contamination has or will occur for this potable water supply (PWS). Our water system provides treatment and regular monitoring to ensure the water delivered to consumers meets all applicable standards.

We obtain water from the New York City water supply system. Water either comes from the Catskill watersheds west of the Hudson River and/or from the Amawalk watershed in Putnam and Westchester counties. The New York City Department of Environmental Protection (DEP) implements a series of programs to evaluate and protect source water quality within these watersheds. Their efforts focus on three important program areas: the enforcement of strengthened Watershed Rules and Regulations; the acquisition and protection of watershed lands; and implementation of partnership programs that target specific sources of pollution in the watersheds. Due to these intensive efforts, the SWAP methodologies applied to the rest of the state were not applied for this PWS. Additional information on the water quality and protection efforts in these New York City watersheds can be found at DEP's website: [www.nyc.gov/dep/watershed](http://www.nyc.gov/dep/watershed).

The main water quality concerns associated with land cover in these watersheds are agriculture and residential land uses which can contribute microbial contaminants, pesticides, and algae producing nutrients. There are also some concerns associated with wastewater, but advanced treatments which reduce contaminants are in place for most of these discharges. Additionally, the presence of other discrete facilities, such as landfills, chemical bulk storages, etc. could lead to some local impacts on water quality, but significant problems associated with these facilities are unlikely due to the size of the watershed and surveillance and management practices.



## HOW CAN THE PUBLIC BE INVOLVED?

The Yorktown Town Board discusses water-related issues on an as-needed basis. For more information please visit the Town's website at [www.yorktownny.org](http://www.yorktownny.org). Additionally, Board of Directors meetings, which consist of Town Supervisors from Yorktown, Montrose, Somers and Cortlandt, are held monthly. For more information regarding the Board of Director's meetings please contact Northern Westchester Joint Waterworks (N.W.J.W.W.) at 914-788-3400.

## FACTS AND FIGURES

Our water system serves approximately 36,000 people and has approximately 10,000 service connections. In 2019, the Water District purchased approximately 931 million gallons of water, sold 765 million gallons of water to metered customers in Yorktown, Cortlandt, Somers, Putnam Valley and Mill Pond Water Districts. The daily average amount of water treated and delivered to our customers was approximately 2.1 million gallons per day. This leaves 166 million gallons of water unaccounted for during the year, which is about 17.8% of the total amount purchased. Unaccounted for water was primarily lost due to semi-annual hydrant flushing, water main breaks, system leakage, fire flow tests, inaccurate water meters, fighting fires and various projects town wide.

In 2019, the base water rate was \$64.35 for the first 9,000 gallons of water and \$7.15 per 1,000 gallons thereafter (out of district customers paid double this amount, respectively). The average bulk rate paid by Putnam Valley was \$15.83 and Mill Pond was 17.71. The rate of penalty charge for late payment of water charges was 10% per a four month billing period. The average annual water charge was \$690 per household.

## WATER SUPPLY AND TREATMENT SECURITY

Security in and around the water treatment plants and water storage areas was increased including better fencing, locks and surveillance equipment, increased visual inspections and patrols of all facilities.

## INVENTORY:

YCWD system is currently comprised of 1,700 hydrants; 1,700 hydrant valves; 1,900 street valves; 9,300 curb boxes and 180 miles of water main.

## SYSTEM IMPROVEMENTS/ON-GOING SYSTEM MAINTENANCE

In 2019, the following distribution projects were completed:

- A total of 30 water main breaks occurred during the year;
- Over 600 fire hydrants were checked for operation and/or flushed;
- 4 hydrants were repaired;
- 3 new fire hydrants was installed;
- Several hundred fire hydrants were painted and reflective snow markers were attached;
- 36 system valves were either installed, replaced or rebuilt as part of our valve replacement program;
- 198 curb boxes were repaired or replaced;
- 195 new water meters were installed and connected to the antennae based (automatic meter reading) system;
- 15 valve boxes were repaired;
- 6 meter pits were repaired or replaced;
- 1,751 water line "mark outs" were performed for compliance with NYS Dig Safe code regulation;
- A leak detection survey was performed by Water District staff on the entire distribution system;
- 169 backflow inspections were performed;
- 33 responses to "possible main break" calls (checked for leaks);
- 117 water shut-off requests were addressed.

## SYSTEM IMPROVEMETS EXPECTED FOR 2020

In order to ensure that our residents receive the highest quality water, the YCWD will continue it's ongoing water infrastructure maintainance and improvements during 2020. To this end:


- Two of our water storage tanks will be professionally inspected and recommended repairs will be made accordingly;
- Our isolation valve replacement program will continue in 2020;
- Our fire hydrant replacement program will be ongoing;
- Agressively continue to replace outdated water meters for better usage accounting;
- We anticipate the commencement of a commercial water meter testing program pursuant to which meters sized larger than 1" will be required to be tested every three years for accuracy;
- In addition to our daily water quality sampling, lead & copper water testing (required every three years) will occur in summer of 2020.

This just a snapshot of what we anticipate for the 2020. With the onset of the Covid-19 Virus in early 2020, the Yorktown Consolidated Water District (as an essential infrastructure entity) has had to adjust some of it's improvement timelines. We anticipate returning to our scheduled plans as soon as possible.

## ARE THERE CONTAMINANTS IN OUR DRINKING WATER?

As required by State regulations, we routinely test your drinking water for numerous contaminants. These contaminants include total coliform, turbidity, inorganic compounds, nitrate, nitrite, volatile organic compounds, total trihalomethanes, and synthetic organic compounds. Table 1 describes which parameters were detected in your drinking water. The State allows us to test for some contaminants less than once per year because the concentrations of these contaminants do not change frequently. Substances not detected in water samples are listed in the paragraph entitled “non-detected substances and the frequency of testing.” Copies of all of the test results listed in Tables 1 and the non-detected substances, compiled as the “Annual Water Quality Report Supplement,” are available for examination at the Yorktown Water District office.

It should be noted that all drinking water, including bottled drinking water, may be reasonably expected to contain at least small amounts of contaminants. The presence of contaminants does not necessarily indicate that water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency’s (EPA) Safe Drinking Water Hotline at (800-426-4791) and <https://www.epa.gov/sdwa> or the Westchester County DOH at (914) 813-5000 and <http://health.westchestergov.com/>.

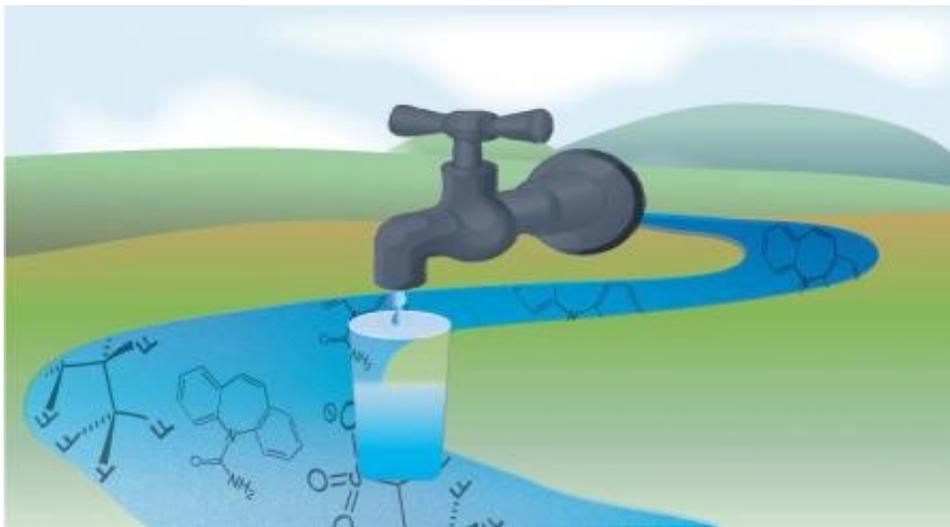

## WHAT DOES THIS INFORMATION MEAN?

Although a few contaminants were detected by our testing, their concentrations were below the levels determined by the State and the EPA to cause health concerns.

## DETECTED SUBSTANCES

Contaminants	Violation Yes/No	Date of Sample (Amawalk/Catskill)	Average Level Detected Amawalk (Range)	Average Level Detected Catskill (Range)	Unit Measurement	MCLG	Regulatory Limit (MCL, TT, or AL)	Likely Source of Contaminants
<b>Inorganic</b>								
Alkalinity	no	Daily	71.79 (24.40-90.80)	22.29 (5.40-72.3*)	mg/L as CaCO <sub>3</sub>	N/A	N/A	Naturally occurring
Hardness	no	Daily	73.00 (28.80-115.00)	24.50 (48.75-103.80*)	mg/L as CaCO <sub>3</sub>	N/A	N/A	Naturally occurring
Aluminum	no	5-31-19	<0.2	<0.2	mg/L	N/A	N/A	In common water treatment chemical
Barium	no	5-31-19	0.399	0.007	mg/L	2	MCL 2	Erosion of natural deposits.
Chloride	no	5-22-19	142	10.40	mg/L	N/A	MCL 250	Naturally occurring or road salt
Chlorine, Free	no	Daily	1.66 (1.45-2.75)	1.24 (0.69-2.82)	mg/L	N/A	MRDL 4	Water additive to control microbes
Fluoride **	no	Daily	<0.10	<0.10	mg/L	N/A	MCL 2.2	Additive which promotes strong teeth
Nitrate as N	no	5-30-19 / 5-29-19	<0.050	<0.050	mg/L	10	MCL 10	Erosion of natural deposits, fertilizer runoff
pH	no	Daily	7.66 (6.99-8.25)	7.67 (7.31-8.35)	N/A	N/A	N/A	N/A
Phosphorus, Ortho	no	Daily	0.82 (0.21-1.35)	0.78 (0.37-1.44)	mg/L	N/A	N/A	Additive to prevent corrosion
Sodium	no	5-31-19	69.5	7.89	mg/L	N/A	(20) <sup>1</sup>	Naturally occurring or road salt
Sulfate	no	5-22-19	9.6	<5.0	mg/L	N/A	MCL 250	Naturally occurring

Contaminants	Violation Yes/No	Date of Sample	Average Level Detected (Range)	Unit Measurement	MCLG	Regulatory Limit (MCL, TT or AL)	# Samples	# Samples above AL	Range of results above AL	Likely Source of Contaminants
<b>Inorganic</b>										
Copper	no	7/26/17-9/28/17	84.1 <sup>2</sup> (2.3-92.6)	ug/L	1300	AL 1300	30	0	0	Corrosion of household plumbing systems; erosion of natural deposits
Lead	no	7/26/17-9/28/17	2.7 <sup>3</sup> (<1.0-17.0)	ug/L	0	AL 15	30	1	17	Corrosion of household plumbing systems; erosion of natural deposits

Contaminants	Violation Yes or No	Date of Sample	Level Detected	MCLG	Regulatory Limit	Likely Source of Contaminants
Total Coliform Bacteria	no	Feb. 2019 April 2019	1 positive sample 1 positive sample	n/a	More than 5% of the samples are positive	Naturally present in environment

Contaminants	Violation Yes/No	Date of Sample (Amawalk/Catkill)	Level Detected Amawalk Average (Range)	Level Detected Catskill Average (Range)	Unit Measurement	MCLG	Regulatory Limit (MCL, TT or AL)	Likely Source of Contaminants
Filtration Turbidity <sup>4</sup>	no	4/24/19 & 12/30/19 / 8/14/19	0.29	0.24	NTU	N/A	TT=99% of samples <0.3 NTU	Soil runoff.
Distribution Turbidity <sup>5</sup>	no	Daily	0.16 (0.06-0.51)		NTU	N/A	MCL 5.0 NTU	Soil runoff.

Contaminants	Violation Yes/No	Date of Sample	Level Detected (Average & Range)	Unit Measurement	MCLG	Regulatory Limit (MCL, TT or AL)	Likely Source of Contaminants
<b>Organic</b>							
Haloacetic Acids	no	2/3/19-11/08/19	36 (21.9-45.4)	ug/L	N/A	MCL 60 (Annual Average)	By-product of drinking water disinfection needed to kill harmful organisms.
Total Trihalomethanes	no	2/3/19-11/08/19	74.4 (39.4-77.6)	ug/L	N/A	MCL 80 (Annual Average)	By-product of drinking water disinfection needed to kill harmful organisms. TTHMs are formed when source water contains large amounts of organic matter.

Contaminants	Violation Yes/No	Date of Sample (Amawalk/Catkill)	Level Detected Amawalk (Average & Range)	Level Detected Catskill (Average & Range)	Unit Measurement	MCLG	Regulatory Limit (MCL, TT or AL)	Likely Source of Contaminants
<b>Radioactive <sup>6</sup></b>								
Combined Radium 226 & Radium 228	no	9-9-15 / 7-19-12	Not detected	Not detected	pCi/L	0	MCL 5 pCi/L	Decay of natural deposits
Gross Alpha Activity	no	9-9-15 / 7-19-12	Not detected	Not detected	pCi/L	0	MCL 15	Decay of natural deposits.
Gross Beta Activity <sup>7</sup>	no	9-9-15 / 7-19-12	Not detected	Not detected	pCi/L	0	MCL 50 pCi/L	Decay of natural deposits and human-made emissions.
Total Uranium	no	9-9-15 / 7-19-12	Not detected	Not detected	ug/L	0	30 ug/L	Erosion of natural deposits.

\* Maximum alkalinity taken while Campfield pump station was online (Source Water = Hollowbrook).

\*\* NJJWW did not introduce fluoride into YWD's potable water as per an understanding with the Westchester County DOH. Once a new fluoride injection site is constructed fluoride will once again be introduced into our distribution system. Contact Jeffrey Dahlke at 914-245-6111 ext. 31 should you have any questions.

1. People on severely restricted sodium diets should not consume water containing more than 20 mg/L of sodium. Water containing more than 270 mg/L of sodium should not be used by people on moderately restrictive sodium diets.
2. This concentration presented represents the 90<sup>th</sup> percentile of the 30 sites tested for copper in 2017. A percentile is a value on a scale of 100 that indicates the percent of a distribution that is equal to or below it. The 90<sup>th</sup> percentile is equal to or greater than 90% of the copper values detected at your water system. This value was 84.1 ug/L. The action level was not exceeded at any of the sites tested.
3. This concentration represents the 90<sup>th</sup> percentile of the 30 sites tested for lead in 2017. This value was 2.7 ug/L. The action level for lead of 15 ug/L was exceeded at one of the 30 sites tested. Sample frequency for lead & copper is every three years.
4. Turbidity is a good indicator of the effectiveness of our filtration system. At least 95% of the samples collected must be below 0.30 NTU.
5. Turbidity is a measure of the cloudiness of the water. The monthly average of the samples must be below 5.0 NTU.
6. Sample frequency every 9 years.
7. The State considers 50 pCi/L to be a level of concern for Beta particles.

#### **Definitions:**

N/A: Not Applicable

*Picocuries per liter (pCi/L):* A measure of the radioactivity in water.

*Maximum Contaminant Level (MCL):* The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible.

*Maximum Contaminant Level Goal (MCLG):* The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

*Action Level (AL):* The concentration of a contaminant, if exceeded, triggers treatment or other requirements that a water system must follow.

*Treatment Technique (TT):* A required process intended to reduce the level of a contaminant in drinking water.

*Nephelometric Turbidity Unit (NTU):* A measure of the clarity of water. Turbidity in excess of 5 NTU is just noticeable to the average person.

*Milligrams per liter (mg/l):* Corresponds to one part of liquid in one million parts of liquid (parts per million – ppm).

*Micrograms per liter (ug/l):* Corresponds to one part of liquid in one billion parts of liquid (parts per billion – ppb).

*Maximum Residual Disinfectant Level (MRDL):* The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbiological contaminants.

*Maximum Residual Disinfectant Level Goal (MRDLG):* The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbiological contamination.

## DO I NEED TO TAKE SPECIAL PRECAUTIONS?

Although our drinking water met state and federal regulations, some may be more vulnerable to disease causing micro-organisms or pathogens compared to the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, persons with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice from their health care provider about their drinking water. EPA/Center for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by Cryptosporidium, Giardia and other microbial pathogens are available from the EPA's Safe Drinking Water Hotline (800-426-4791).

Lead was below the Action Level of 15 ug/L in 29 of the 30 first draw water samples collected. We present the following required statement on lead in drinking water for your information:

"If present, elevated levels of lead can cause serious health problems, especially for pregnant women, infants, and young children. It is possible that lead levels at your home may be higher than at other homes in the community as a result of materials used in your home's plumbing. The Yorktown Water District is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline (1-800-426-4791) or at <https://www.epa.gov/ground-water-and-drinking-water/basic-information-about-lead-drinking-water>."

The amount of copper that we detected was generally low and in all cases was below the Action Level. The government's general health precaution on copper states that people who drink water containing excess copper could experience gastrointestinal distress and that people with Wilson's Disease should consult their personal doctor if they believe that they have ingested an excess amount of copper.

## INFORMATION ON TEMPORARY DISCONTINUATION OF FLUORIDE

On October 3, 2017 N.W.J.W.W.'s Amawalk Water Treatment Facility stopped adding Fluoride to its treated water. The fluoride feed system to the Catskill facility has been offline since January 2013 and a new treatment facility has been approved by the Westchester County Department of Health for construction. Due to hydraulics associated with Yorktown's distribution system, N.W.J.W.W. cannot provide an optimal level of fluoride to all residents unless fluoride is added at both facilities. Therefore in consultation with Westchester and NYS Health Departments, as well as Yorktown and Somers officials, the decision was made to temporarily discontinue fluoridation at the Amawalk facility. Contact YCWD, Jeffrey Dahlke at 914-245-6111 ext. 31 should you have any questions.

Since October 3, 2017, supplemental fluoride has not been added to your drinking water. You may want to discuss this with your family dentist to see if some other form of fluoride supplement should be considered for your dental protection.



## NON-DETECTED SUBSTANCES AND THE FREQUENCY OF TESTING

According to State regulations, the following lists of substances (along with test frequencies) were tested for in your drinking water and **not detected**. Bromoacetic acid and bromoform were tested quarterly from four sites. Arsenic, beryllium, cadmium, cyanide, mercury, nickel nitrite, selenium, silver, thallium and zinc were tested for annually. Bromochloromethane, bromomethane, carbon tetrachloride, chloroethane, chloromethane, dichlorodifluoromethane, 1,1-dichloroethane, 1,2-dichloroethane, 1,1-dichloroethene, cis-1, 2-dichloroethene, trans-1, 2-dichloroethene, 1,2-dichloropropane, 1,3-dichloropropane, 2,2-dichloropropane, 1,1-dichloropropene, cis-1, 3-dichloropropene, trans-1, 3-dichloropropene, methylene chloride, 1,1,1,2-tetrachloroethane, 1,1,2,2-tetrachloroethane, tetrachloroethene, 1,1,1-trichloroethane, 1,1,2-trichloroethane, trichloroethene, trichlorofluoromethane, 1,2,3-trichloropropane, vinyl chloride, benzene, bromobenzene, n-butylbenzene, sec-butylbenzene, tert-butylbenzene, chlorobenzene, 2-chlorotoluene, 4-chlorotoluene, 1,2-dichlorobenzene, 1,3-dichlorobenzene, 1,4-dichlorobenzene, ethyl benzene, hexachlorobutadiene, isopropylbenzene, p-isopropyltoluene, n-propylbenzene, styrene, toluene, 1,2,3-trichlorobenzene, 1,2,4-trichlorobenzene, 1,2,4-trimethylbenzene, 1,3,5-trichloromethylbenzen, p&m-xylene, o-xylene, methyl t-butyl ether, 1,2-dibromoethane, 1,2-dibromo-3-chloropropane, aldrin, dieldrin, chlordane, endrin, heptachlor, heptachlor epoxide, lindane, methoxychlor, toxaphene, propachlor, PCB's, 2,4-D, 2,4,5-T, silvex, dalapon, dicamba, dinoseb, pentachlorophenol, picloram, alachlor, atrazine, simazine, hexachlorobenzene, hexachlorocyclopentadiene, benzo(a)pyrene, di (2-ethylhexyl) adipate, aldicarb sulfoxide, aldicarb sulfone, oxamyl, methomyl, 3-hydroxycarbofuran, aldicarb, carbofuran, carbaryl, glyphosate, chloroform, dibromochloromethane, 1,2-dichloroethene, 1,2 dichlorobenzene-d4, 4-bromofluorobenzene, endothall, diquat, butachlor, bis(2-ethylhexyl) phthalate, metochlor and metribuzin were tested annually.

## WHY SAVE WATER AND HOW TO AVOID WASTING IT?

Although our system has an adequate amount of water to meet present and future demands, there are a number of reasons why it is important to conserve water:

- \*Saving water saves energy needed to treat and deliver the water;
- \*Saving water reduces the need to construct costly new sources, pumping systems and water storage reservoirs; and,
- \*Saving water lessens the strain on the water system during a dry spell or drought, helping to avoid severe water use restrictions so that essential fire fighting needs are met.

## HOW CAN I CONSERVE MY WATER?

Know how much water your household uses, and look for ways to use less whenever you can:

- \*Automatic dishwashers use about 15 gallons for every cycle, regardless of how many dishes are loaded. So get a run for your money and load it to capacity



- \*Turn off the tap when brushing your teeth and when shaving.
- \*Check every faucet in your home for leaks. Just a slow drip can waste 15 to 20 gallons a day. Fix it and you can save almost 6,000 gallons per year.
- \*Check your toilets for leaks by putting a few drops of food coloring in the tank, watch for a few minutes to see if the color shows up in the bowl. It is not uncommon to lose up to 100 gallons a day from one of these otherwise invisible toilet leaks. Fix it and save more than 30,000 gallons a year.
- \*Use your water meter to detect hidden leaks. Simply turn off all taps and water using appliances, and then check the meter after 15 minutes. If it moved, you have a leak.

## CLOSING STATEMENT

It is the YCWD's mission to provide the highest quality of drinking water to all our customers. We ask everyone to help us protect our water sources, which are the heart of our community and our way of life. Hard copies of this report are available at the Yorktown Water District Office, the Yorktown Town Hall, the Albert A. Capellini Community and Cultural Center and the John C. Hart Library.

If you have questions concerning your drinking water, please don't hesitate to call us at (914) 245-6111.